
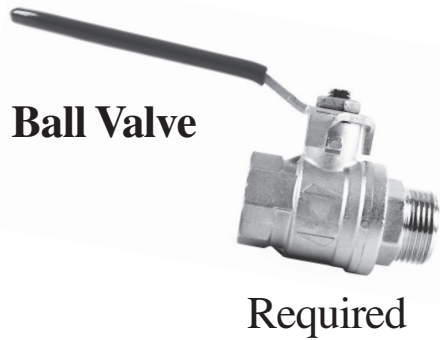


# Minimum RLCWA Specifications

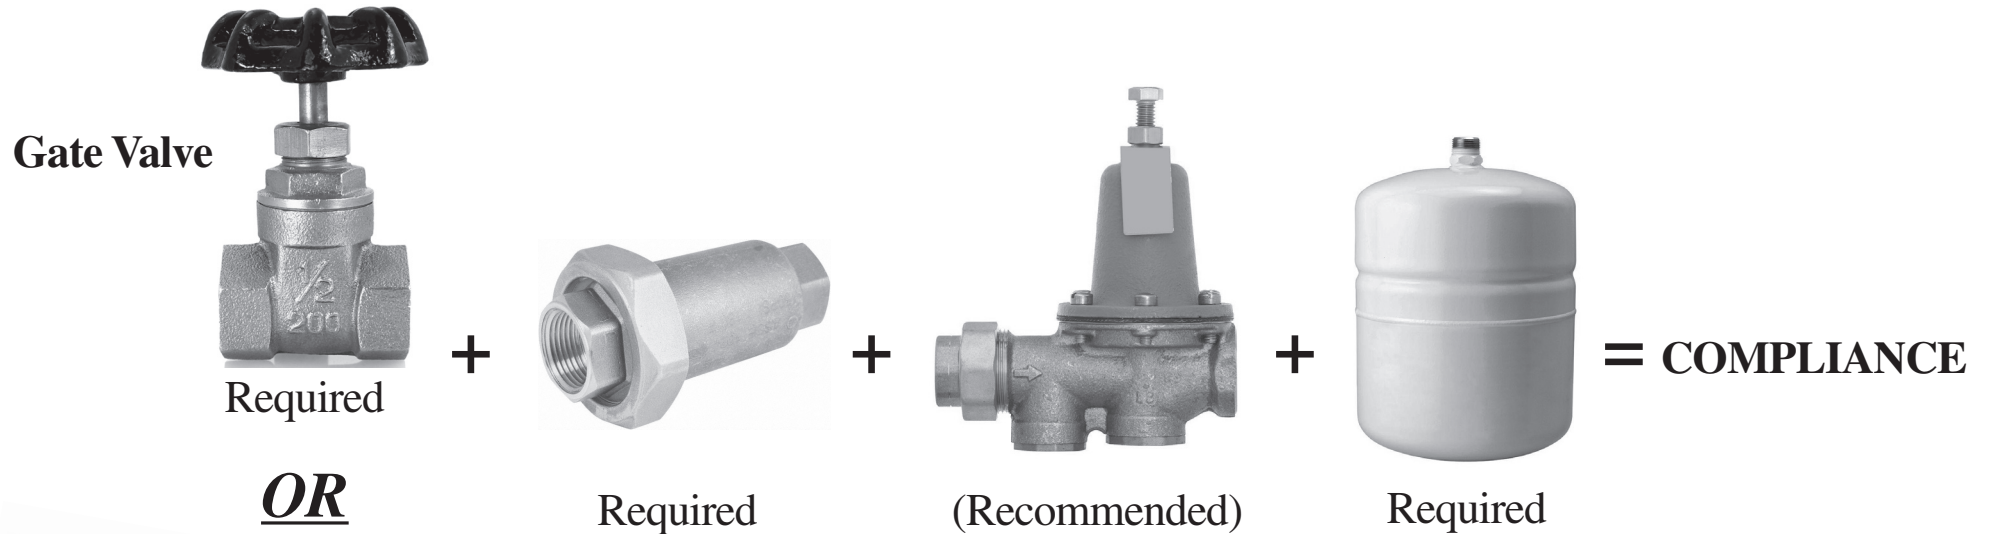

OR

Required


ASSE 1024  
Dual Check

Pressure  
Regulating  
Valve

Expansion  
Tank

Boiler Feed Line with No Additives

=

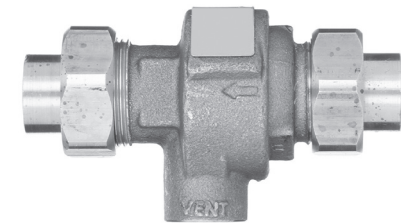

ASSE 1012  
Dual Check with  
Atmospheric Vent



**RURAL LORAIN COUNTY WATER AUTHORITY**

42401 State Route 303 • LaGrange, Ohio 44050 • Phone 440-355-5121 • Fax 440-355-6628

**An inspection is REQUIRED after the plumbing has been completed. If you have questions please contact the backflow department at 1-800-842-1339.**